




GE Appliances

DCXR463EAAA - GE Extra-Large 6.0 Cu. Ft. Capacity Dryer

Dryer Dimensions (in inches)

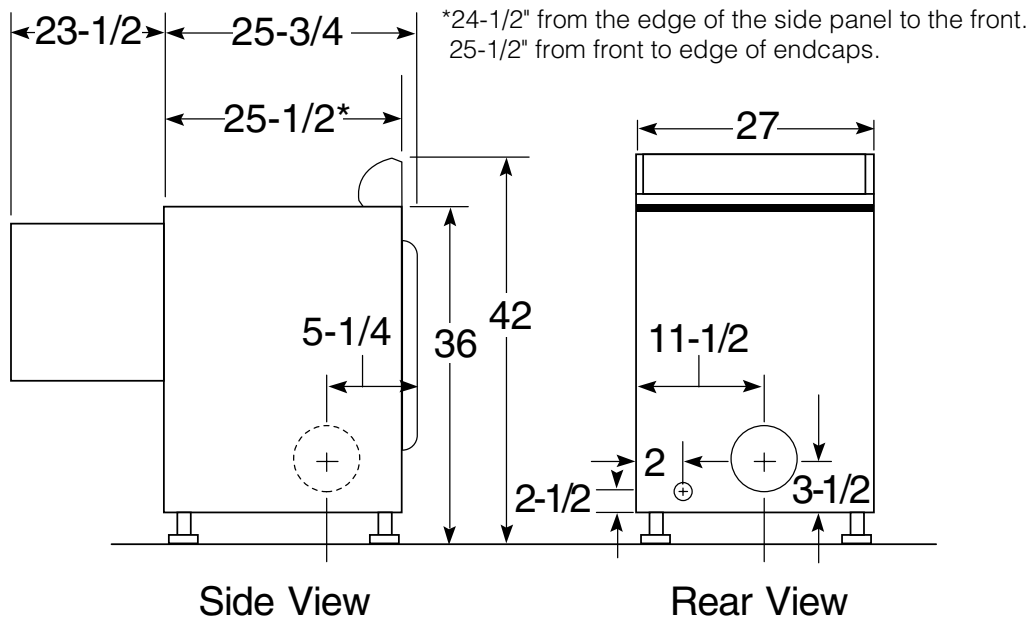

Exhaust Options:

4-way via rear, right, left and bottom.

Circuit Requirements:

An individual, properly-grounded branch circuit, protected by a 30-amp circuit breaker or a time-delay fuse, is required.

Electric Dryer Rating:

208/240V, 5600W, 24A, 60Hz

208V, 4400W, 22A, 60Hz

Note: Dryer wall outlet must be located within 36" of service cord entry and accessible when dryer is mounted in position.

Installation Information: For complete information, see installation instructions packed with your dryer.

Specification Revised 9/00

For answers to your Monogram®
GE Profile Performance Series™
GE Profile™ or GE appliance questions, call
GE Answer Center® service, 800.626.2000.




Listed by
Underwriters
Laboratories



GE Appliances

DCXR463EAAA - GE Extra-Large 6.0 Cu. Ft. Capacity Dryer

Dryer Exhausting Information—Use Metal Duct Only

 Domestic Dryer Models	Number of 90° Turns	Best Performance		Maximum Length of 4\" data-bbox="187 253 369 318">	
		Maximum Length of 4\" data-bbox="187 273 369 318">		Maximum Length of 4\" data-bbox="187 273 369 318">	
		Cat. No. WX8X59 (Preferred) A	B	Cat. No. WX8X59 (Preferred) A	B
		4\" data-bbox="187 318 369 388">	2-1/2\" data-bbox="187 318 369 388">	4\" data-bbox="187 318 369 388">	2-1/2\" data-bbox="187 318 369 388">
Super & Extra-Large 6.0 Capacity Models All Electric Dryers	0	90 ft.	60 ft.	55 ft.	45 ft.
	1	60 ft.	45 ft.	40 ft.	30 ft.
	2	45 ft.	35 ft.	30 ft.	20 ft.
	3	35 ft.	25 ft.	20 ft.	15 ft.
Super & Extra-Large 6.0 Capacity Models All Gas Dryers	4	25 ft.	15 ft.	15 ft.	10 ft.
	0	45 ft.	30 ft.	30 ft.	15 ft.
	1	35 ft.	20 ft.	20 ft.	10 ft.
	2	25 ft.	10 ft.	10 ft.	—
Extra-Large 5.7 Capacity Electric and Gas Dryers	3	15 ft.	—	—	—
	0	60 ft.	48 ft.	30 ft.	18 ft.
	1	52 ft.	40 ft.	22 ft.	14 ft.
	2	44 ft.	32 ft.	14 ft.	10 ft.
	3	32 ft.	24 ft.	—	—
	4	28 ft.	16 ft.	—	—

Special Installation Requirements

Alcove or Closet Installation:

- If your dryer is approved for installation in an alcove or closet, it will be stated on a label on the dryer back.
- The dryer **MUST** be exhausted to the outside.
- Minimum clearances between dryer cabinet and adjacent walls or other surfaces are:
 - 0\" data-bbox="98 681 147 693">either side
 - 3\" data-bbox="98 693 157 705">front and rear
- Minimum vertical space from floor to overhead cabinets, ceilings, etc. is 52\" data-bbox="311 708 334 720">.
- Closet doors must be louvered or otherwise ventilated and must contain a minimum of 60 sq. in. of open area equally distributed. If this closet contains both a washer and a dryer, doors must contain a minimum of 120 sq. in. of open area equally distributed.
- The closet should be vented to the outdoors to prevent gas pocketing in case of a gas leak in the supply line.
- No other fuel-burning appliance shall be installed in the same closet with the dryer.

Bathroom or Bedroom Installation:

- The dryer **MUST** be exhausted to the outdoors.
- The installation must conform with the local codes, or in the absence of local codes, with the National Fuel Gas Code, ANSI Z223.

Minimum Clearances other than Alcove or Closet Installation:

- Minimum clearances to combustible surfaces
 - 0\" data-bbox="98 888 147 900">both sides
 - 3\" data-bbox="98 900 124 912">rear

Specification Revised 9/00

For complete information, see installation instructions packed with your dryer.

Ducting Materials:

For best performance, this dryer should be vented with 4\" data-bbox="489 277 950 328">duct cannot be used, then "flexible all metal" venting can be used, but it will reduce the maximum recommended duct length.

Exhaust Length Calculation:

1. Determine the number of 90° turns needed for your installation. If you exhaust to the side or bottom of dryer, add one turn.
2. The maximum length of 4\" data-bbox="489 398 883 430">in the table. The maximum length for flexible ducts are less than for rigid duct.

A turn of 45° or less may be ignored. Two 45° turns within the duct length should be treated as a 90° elbow. A turn over 45° should be treated as a 90° elbow.

Exhausting the dryer to the outside is strongly recommended to prevent large amounts of moisture and lint from being blown into the room. Gas dryers or any dryer located in a closet **must** be exhausted to the outside.

Caution: For personal safety do not terminate exhaust into a chimney, under any enclosed house floor (crawl space), or into an attic, since the accumulated lint could create a fire hazard or moisture could cause damage. Never terminate the exhaust into a common duct or plenum with a kitchen exhaust, since the combination of lint and grease could create a fire hazard.

Exhaust ducts should be terminated in a dampered wall cap to prevent back drafts, bird nesting, etc. The wall cap must also be located at least 12\" data-bbox="489 618 943 633">cap must also be located at least 12\" data-bbox="489 618 943 633">above the ground or any other obstruction with the opening pointed Down.

Other terminations, such as louvered wall boxes, are acceptable provided they are equivalent to a 4\" data-bbox="489 641 941 675">dampered wall cap.

For more information on venting kits and accessories, please call 1-800-GE CARES.

For answers to your Monogram[®]
GE Profile Performance Series,[™]
GE Profile[™] or GE appliance questions, call
GE Answer Center[®] service, 800.626.2000.




Listed by
Underwriters
Laboratories



GE Appliances

DCXR463EAAA - GE Extra-Large 6.0 Cu. Ft. Capacity Dryer

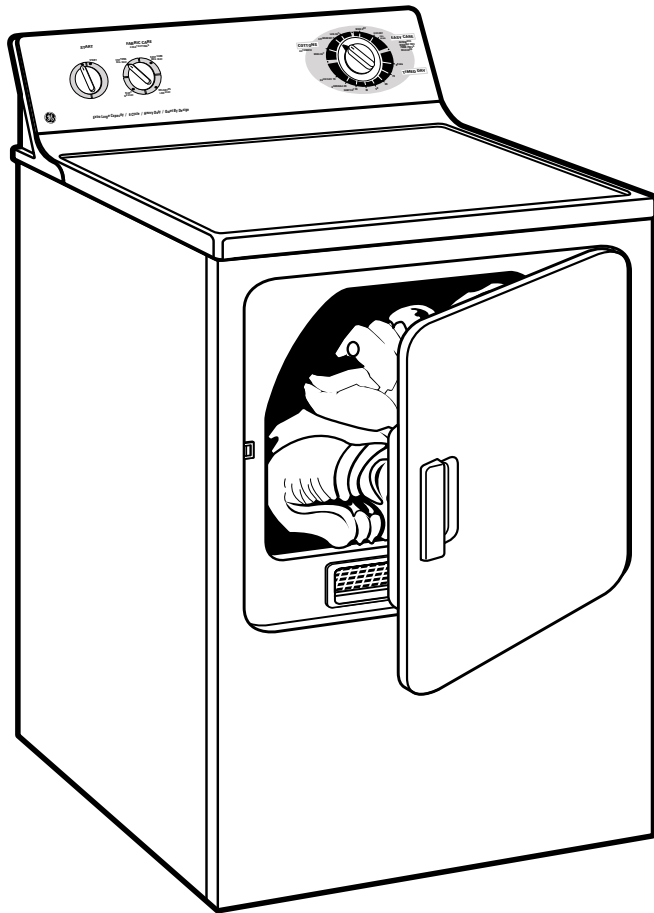

Features and Benefits

- Extra-Large (6.0 cu. ft.) Dryer
- Automatic Dry Control
- 4 Heat Selections
- 6 Cycles:
 - Automatic Cottons Cycle
 - Easy Care Cycle with Auto Wrinkle Free / Permanent Press
 - Timed Dry (80 Min.) with Damp Dry, Quick Dry and De-Wrinkle
- Dryer Interior Light
- Removable Up-Front Lint Filter
- DuraDrum™ Interior
- Quiet-By-Design™
- Reverse-A-Door
- 100% Front Serviceable
- Model DCXR463EAWW - White on white
- Model DCXR463EAAA - Almond on almond
- Model DCXR463GAWW - White on white
- Model DCXR463GAAA - Almond on almond